

ULTRASONIC FLOW METER 201



Introduction


201 is a wall-mount, clamp-on type ultrasonic flow meter which uses the transfer time technology. Designed using FPGA chip and low-voltage broadband pulse transmission.

Both Clamp on type sensors and Insertion type sensors are available.

201 has a 240*128 back lit LCD with 4 line menu display and also the clear, user-friendly menu selections make flow meter more simple and convenient to use.

Daily, monthly and yearly totalized flow.

Parallel operation of positive, negative and net flow totalizes with scale factor (span) and BTU Capacity. While the output of totalize pulse and frequency output are transmitted via relay and open collector.

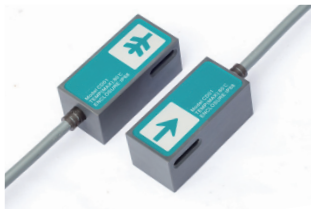

201 could add the RTD model and temperature sensor become an energy meter to monitoring the energy use, help to save the energy.

Application

201 ultrasonic flowmeter widely application in HVAC, water treatment, irrigation.



Specification

Performance

Flow range	$\pm 0.09\text{ft/s} \sim \pm 16\text{ft/s}$ ($\pm 0.03\text{m/s} \sim \pm 5\text{m/s}$)
Accuracy	$\pm 1\%$ of measured value
Repeatability	0.2% of measured value
Linearity	$\pm 1\%$
Pipe size	1" to 48" (25mm to 1200mm). Pipe size under 1" is an option
Fluid	Water

Function

Outputs	Analog output: 4~20mA, max load 750 Ω . Pulse output: 0~10KHz
Communication	RS232/RS485 Modbus
Power supply	10~36VDC/1A
Display	240*128 back lit LCD
Temperature	Transmitter: -14°F ~ 140°F (-20°C ~ 60°C) Transducer: -40°F ~ 176°F (-40°C ~ 80°C, standard)
Humidity	Up to 99% RH, non-condensing


Physical

Transmitter	PC/ABS, IP65
Transducer	ABS, IP68 Encapsulated design Double-shielded transducer cable Standard/maximum cable length: 30ft/900ft (9m/274m)

ULTRASONIC FLOW METER 201

Product size

Transmitter size

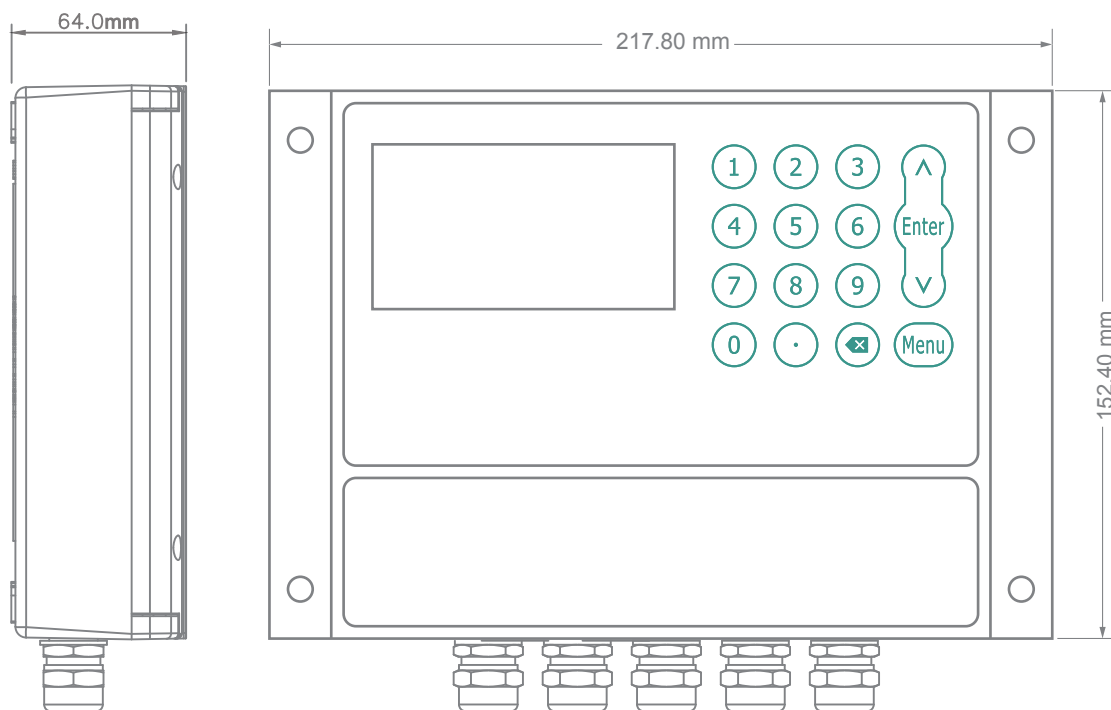


Transducer size




Installation site selection

The first condition for ultrasonic flow meter is the pipe must be full of liquid, the bubbles will greatly influence the accuracy of the measurement, please avoid the follow installation position:

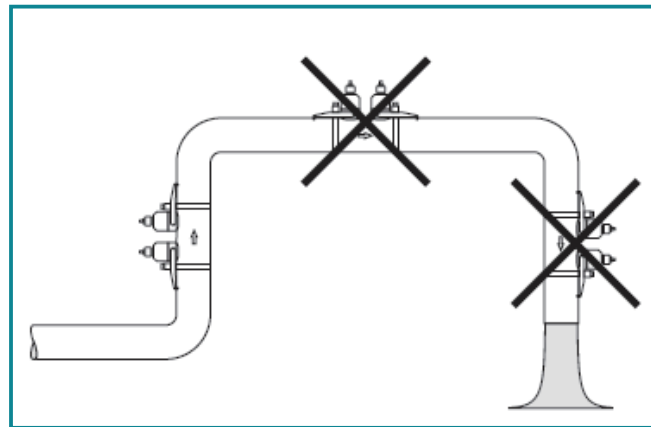


The suggestion installation area is as following:

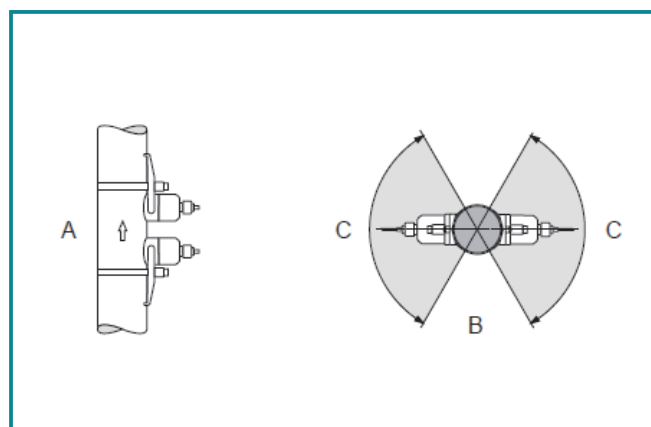

- A is for upright pipeline, please notice the water direction is from the bottom to top.
- B is for horizontal pipeline, the transducers need to be installed inside the C area, angle for area C, max 120°.


Straight pipe demand

We suggest avoiding the valve, T-branch pipe and elbows if the condition allow. Please satisfied the hardest position installation requirements when you face more than one interfering resource.

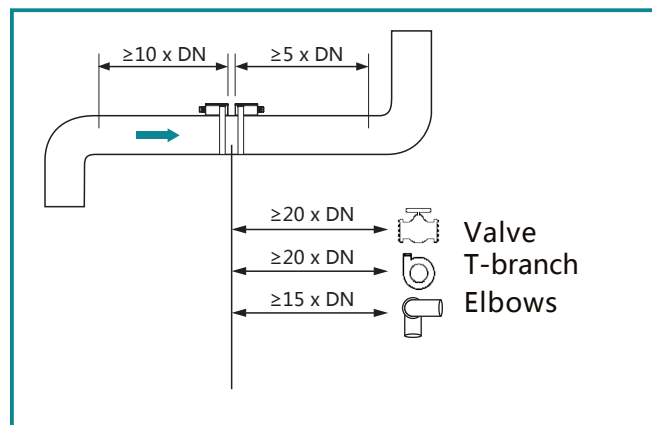

Measuring principle

Transfer time technical means the ultrasonic signal from the transducer is transmitted and received through the moving liquid, there will be a difference between the upstream and downstream transit time, which can be used to calculate flow and velocity.

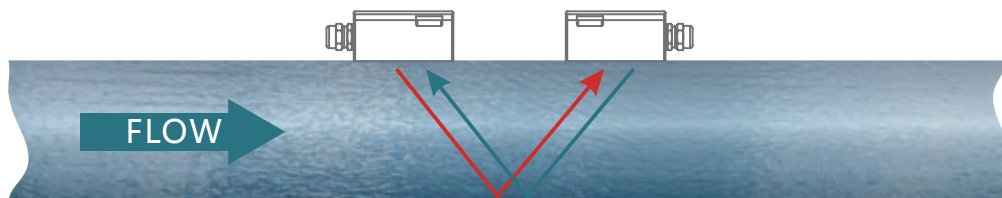

Ordering confirmation

Transmitter

Ultrasonic flowmeter
 Wall mount
 Flow range : $\pm 0.09\text{ft/s} \sim \pm 16\text{ft/s}$ ($\pm 0.03\text{m/s} \sim \pm 5\text{m/s}$)
 Accuracy : $\pm 1\%$ of the measure value
 Repeatability : 0.2% of the measure value
 Display : 240*128 back lit LCD
 Power supply : 10-36VDC@1A max
 Transmitter enclosure: IP65, ABS (Temperature: $-20^{\circ}\text{C} \sim 50^{\circ}\text{C}$)
 Output: OCT pulse output 0-10KHz, Relay output, 4-20mA optional
 Communication: RS232, Modbus Protocol

Code	Type of Transmitter
1	OCT, Relay, RS232/RS485, 4-20mA
2	OCT, Relay, RS232/RS485, 4-20mA , RTD
Code	Type of Transmitter
CD01	Clamp-on, IP68. Operating temperature: $-40^{\circ}\text{F} \sim +176^{\circ}\text{F}$ ($-40^{\circ}\text{C} \sim +80^{\circ}\text{C}$)
C1	Clamp-on, IP68. Operating temperature: $-40^{\circ}\text{F} \sim +176^{\circ}\text{F}$ ($-40^{\circ}\text{C} \sim +80^{\circ}\text{C}$)
C2	Clamp-on, IP68. 2MHz Pipe size DN15 to DN25 only Operating temperature: $32^{\circ}\text{F} \sim 140^{\circ}\text{F}$ ($0^{\circ}\text{C} \sim +60^{\circ}\text{C}$)
C1U	Clamp-on, IP68. Operating temperature: $-40^{\circ}\text{F} \sim +266^{\circ}\text{F}$ ($-40^{\circ}\text{C} \sim +130^{\circ}\text{C}$)
W1	Insertion, IP68. Operating temperature: $-40^{\circ}\text{F} \sim +266^{\circ}\text{F}$ ($-40^{\circ}\text{C} \sim +130^{\circ}\text{C}$)
XXX	Transducer cable length
030	Standard length 30ft (9m)
XXX	Max length to 900ft (274m)
Code	Temperature sensor
PT1000	Pt1000 temperature sensor
Code	Option
AC	AC power, 90 to 245 VAC
SD	SD card

| ULTRASONIC FLOW METER 201

Standard flow meter model:

201-1-CD01-030

Standard enclosure ultrasonic flow meter, OCT, Relay, RS485, 4-20mA, with a pair of CD01 clamp on transducer, 30ft cable.

Standard energy/btu meter model:

201-2-CD01-030-PT1000

Standard enclosure ultrasonic energy/btu meter, OCT, Relay, RS485, 4-20mA, with a pair of CD01 clamp on transducer(30ft cable) and a pair of clamp on type PT1000 sensor (30ft cable).